



सी.पी.पी., ज़ावर माईन्स  
पिन कोड - 313901  
ज़िला - उदयपुर (राज.)

**HINDUSTAN ZINC LIMITED**  
**हिन्दुस्तान जिंक लिमिटेड**  
**Telephone - (0294) 2723400**

CPP, Zawar Mines  
PIN Code - 313901  
Dist - Udaipur (Raj.)

Ref.: HZL/ZM/ CPP/ENV/2024/ 299

Date - 27.08.2024

**By Registered**

The Member Secretary  
Rajasthan State Pollution Control Board  
4- Institutional Area, Jhalana Dungri  
JAIPUR-302004 (Raj.)

Sub.: Environmental Statement for the year 2023-24 for Zawar CPP

**Ref: F(Mines)/Udaipur(Sarada)/50(1)/2016-2017/2021-2023 dated  
21.06.2023**

Sir,

Please find attached herewith the **Environmental Statement** for the year  
**2023-24** for **Zawar Captive Power Plant**

Thanking you

Yours Faithfully

  
**Abhay Pratap Singh**  
**(Head - ZAWAR CPP)**

Encl.: As above

- CC: 1. The Deputy Director (S), Scientist- C, Ministry of Environment, Forest & Climate Change, Integrated Regional Office, B-213 & 216, Aranya Bhawan, Jhalana Institutional Area, Jaipur (Rajasthan)- 302004  
2. The Regional Officer, Rajasthan State Pollution Control Board, F-470, Near UCCI Building, Madri Industrial Area, Udaipur-313003 (Raj.)  
3. Office Copy Env. Cell/ CPP Zawar

**FORM – V****(See Rule- 14)****Environmental Statement for the financial year ending the 31<sup>st</sup> March 2024****PART – A**

(i)	Name and Address of the Owner / Occupier of the Industry / Operation and Process	Sh. Arun Mishra (Occupier) CEO & Whole Time Director Hindustan Zinc Limited, Yashad Bhawan, Udaipur-313001 (Raj)
		Sh. Abhay Pratap Singh (Factory Manager) Head CPP ZAWAR Hindustan Zinc Limited, Zawar Mines Dist.- Udaipur- 313901 (Raj)
(ii)	Industry category	Red
(iii)	Production capacity	90 MW Power Generation
(iv)	Year of establishment	16.12.2008
(v)	Year of last environment statement submitted.	14.09.2023

**PART – B****Water and Raw Material Consumption**(i) Water consumption m<sup>3</sup>/day

Process- 4020.67

Cooling- NA

Domestic- NA

Name of Products		Process water consumption per unit of product output	
		During the previous financial year (2022-23)	During the current financial year (2023-24)
		(1)	(2)
(1) Power		2.48 m <sup>3</sup> /MWh	2.31 m <sup>3</sup> /MWh
(ii) Raw material consumption			
*Name of raw materials	Name of Products	Consumption of Raw material per unit of output*	
		during the previous financial year (2022-23)	during the current financial year (2023-24)
Coal Consumption	Power	477.59	484.70
* gm/kwh			

Increase in coal consumption is due to use of lower GCV coal and higher electricity generation as compared to previous year.

### PART – C

Pollution discharged to environment/unit of output.

(Parameter as specified in the consent issued)

(1) Pollution	Quantity of pollutants discharged (m <sup>3</sup> /day)	Concentration of pollutants in discharges (m <sup>3</sup> /day)	Percentage of variation from prescribed standards with reasons
(a) Water	Zero Discharge	Within the limits as prescribed by RSPCB in Consent to Operate	NIL
(b) Air	Less than 50 mg/Nm <sup>3</sup> of SPM	Within the limits as prescribed by RSPCB in Consent to Operate	NIL

### PART – D

#### HAZARDOUS WASTES

(as specified under Hazardous Wastes (Management, Handling & Transboundary Movement) Rules 2016)

Hazardous wastes	Total quantity during the year (MT)	
	during the previous financial year (2022-23)	during the current financial year (2023-24)
(a) From Process		
Used/Spent Oil Sold	4.96	5.14
(b) From pollution control facility	Nil	Nil

Note: Used oil from entire location is collected and sold from central store of Zawar Mines. As Zawar Mines complex (including CPP) is having common HWs authorization, quantity of oil sold from central store has been mentioned in Environment statement submitted for Zawar mines that includes for entire location including CPP.

### PART – E

#### Solid Wastes

	Total Quantity (MT)			
	during the previous financial year (2022-23)		during the current financial year (2023-24)	
(a) From process				
(b) From Pollution control facility	Fly Ash	Bottom Ash	Fly Ash	Bottom Ash
(c) (1) Quantity recycled or re-utilized within the unit.	-	432.58	-	601.93
(2) Sold	39486.92	4332.91	50259.76	4818.20
(3) Disposed	-	-	-	-

## **PART – F**

Please specify the characteristics (in terms of composition and quantum) of hazardous as well as solid wastes and indicate disposal practice for both of these categories of wastes.

1. The Hazardous Waste generated is used / spent oil which is stored in 220 litre drums and then disposed to registered/ authorized recyclers.
2. Solid wastes generated are Fly Ash and Bottom Ash. These are sold to Cement Plants/ brick manufacturers in suitably designed bulkers owned by the cement plants. Also, bottom ash is partially recycled.

## **PART – G**

Impact of the pollution abatement measures taken on conservation of natural resources and on the cost of production

It may be noted that higher production of power is achieved taking following measures:

- Better capacity utilization of plant and equipment;
- Better maintenance practices resulting in lesser downtime and increased plant availability.
- 8 field ESP to arrest SPM going through chimney to maintain the emission below specified limit.
- Online monitoring system at stack for continuous monitoring of pollutants.
- Zero Discharge is followed. 100% blow down water reused for dust suppression as well for reuse in beneficiation plant
- STP water after treatment is pumped to blow down tank of CPP and utilized in CPP
- Cyclone separators and Bag filters at the transfer points so as to ensure minimum fugitive emission.
- Covered Coal conveyers for conveying of coal.
- Dust suppression and Dust extraction system installed to improve emissions within the plant premises.
- Regular care of the plantation is being taken.



**8 Field ESP**



**Ash Transportation via Bulker**



**Covered conveyor belt**



**Covered Conveyor Belt**




**Transportation via covered trucks**




**Concrete roads in Plant**



**Mist sprinkling system in coal yard**

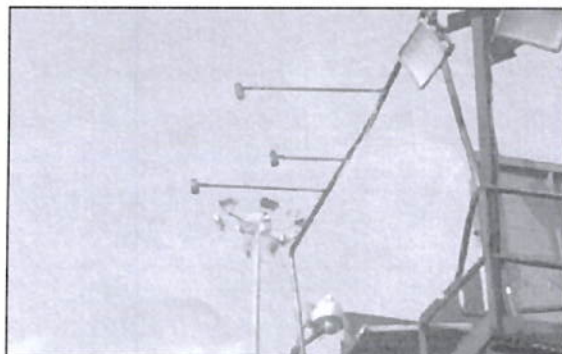


**Water sprinkling system at coal yard**

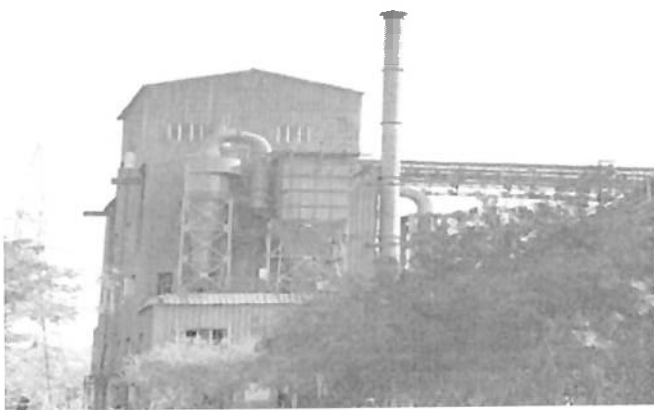

**Coal Crusher Building**



**CAAQMS**

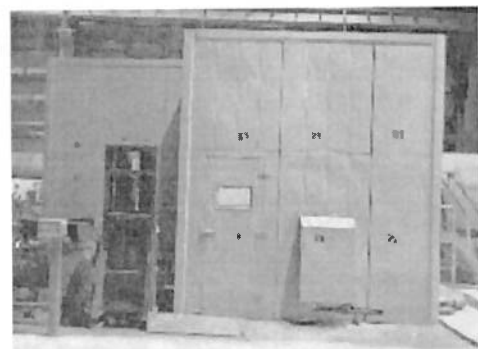

**Acoustic Enclosure for Turbine**



**Plantation Near Boiler Plant**




**Plantation Near Crusher House**




**Plantation Near DM Plant**



**Plantation Near Switch Yard**

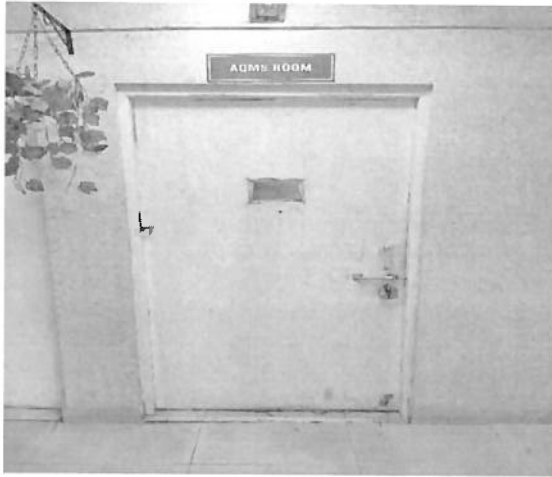

**CAAQMS Station**

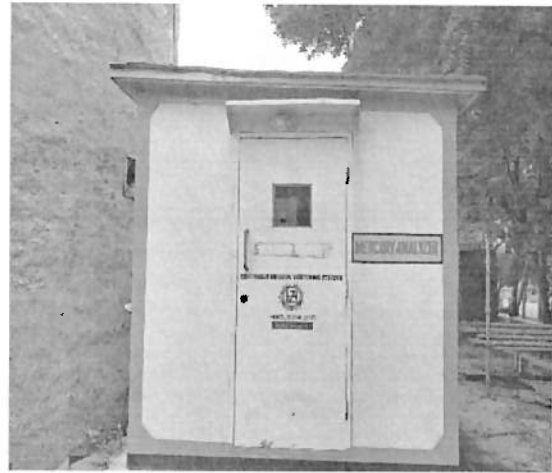

**Stack Mercury Monitoring Station**

### **PART – H**

Additional measures/investment for environmental protection abatement of pollution, prevention of pollution.

1. Water spraying on approach roads, coal yard to minimize fugitive dust outside the plant.
2. Monitoring of ambient air quality on regular basis at four locations, monitoring of both the stacks as well as water sample analysis
3. Proper training given to employees on various environment aspects like waste management, water awareness, climate change management and environment rules and regulation etc.
4. Zavar location including Captive Power Plant is certified for **ISO-9001:2015(QMS), ISO-14001:2015 (EMS), ISO-45001:2018 (OHSMS) and SA-8000:2014 (Social Accountability)**



## PART – I

Any other information for improving the quality of the environment.

1. World Environment day was celebrated on 5<sup>th</sup> June. Various competitions for employees and children were conducted. Prizes were given to the winners on spot.





2. Safety Day was celebrated in the CPP premises.



**3. Energy Conservation Week Celebration:** Celebrated energy conservation week in which various events like poster, slogan & crossword competition were organized. Conserve to preserve hour organized in office premises. Organized **No Vehicle Day** on 14<sup>th</sup> December.



HINDUSTAN ZINC LIMITED					
STACK MONITORING (in mg/Nm3), CPP ZAWAR					
Stacks	ESP				Coal Crusher
Parameters	PM	SOx	Nox	Hg	PM
Limits	50	-	-	0.03	50
Apr-23	34.70	839.50	240.40	Not Detected	32.70
May-23	27.60	820.20	219.70	Not Detected	28.50
Jun-23	29.3	855.7	234.3	0.004 (online data)	25.2
Jul-23	26.9	865.1	240.5	0.002 (online data)	26.7
Aug-23	24.7	810.3	239.8	0.002 (online data)	31.2
Sep-23	28.3	829.7	265.5	0.012 (online data)	29.8
Oct-23	28.0	845.7	219.2	0.012 (online data)	26.5
Nov-23	24.3	809.9	230.5	0.0113 (Online data)	28
Dec-23	26.6	825.3	252	0.007 (Online data)	24.1
Jan-24	23.9	874.4	263.2	0.0069 (Online data)	24.2
Feb-24	27.3	828.1	240.6	0.0073 (Online data)	26.5
Mar-24	29.8	875.3	269.4	0.0047 (Online data)	28.7

### Ambient Air average values (in µg/m<sup>3</sup>) for 2023-24

Location	Parameters	Limits	Apr-23	May-23	Jun-23	Jul-23	Aug-23	Sep-23	Oct-23	Nov-23	Dec-23	Jan-24	Feb-24	Mar-24
Ashok Nagar	PM 10	100	47.9	48.85	48.2	48	49.8	50.3	53.9	48.9	49.8	51.85	52.6	53.15
	PM 2.5	60	29.1	29.8	28.75	28.95	30.2	29.9	32.4	28.65	29.8	31.45	31.7	31.95
	SOx	80	6.1	6.3	6.15	6.25	6.75	6.65	6.75	6.35	6.35	6.65	6.95	6.75
	NOx	80	9.05	8.7	8.05	9.45	10	10.5	10.45	9.1	9.15	10.15	9.9	9.8
	CO	4000	458	572.5	515.5	572.5	744.5	687.5	744.5	573	630	687.5	687.5	687
Weigh Bridge	PM 10	100	53.15	53.95	52.05	52.15	55.75	52.35	58.1	57	56.55	57.55	57.3	61.35
	PM 2.5	60	32.05	32.25	31.15	31.15	33.55	31.5	35.1	34.15	34.3	34.35	34.55	37.2
	SOx	80	7.05	7.05	6.9	7.05	7.8	7.25	8	7.55	7.35	7.45	7.45	7.85
	NOx	80	11.8	12.15	11.9	12.25	14.1	11.4	14.3	12.1	12.35	12.95	12	13.65
	CO	4000	630	687.5	630	630	859	744.5	859	744.5	744.5	801.5	801.5	802
Main Gate	PM 10	100	58.45	57.85	56.4	56.15	57.95	58.55	60.55	61.05	61.65	61.55	56.3	59.8
	PM 2.5	60	35	34.3	34.5	33.6	34.6	35.55	36.05	36.45	37.3	36.95	34.6	35.8
	SOx	80	7.75	7.85	7.8	7.55	8.25	8.4	8.65	7.7	7.7	8.75	7.65	8
	NOx	80	14.1	13.75	13.9	13.8	14.8	14.95	15.7	13.5	13.75	16.1	13.2	14.15
	CO	4000	744.5	744.5	687	744.5	916	916.5	916	802	859	916.5	744.5	859
MAS Office	PM 10	100	53.45	52.5	51.35	52.4	51.25	51.95	56.3	52.85	53.8	55	57.05	56.1
	PM 2.5	60	32.55	31.85	30.85	31.6	31.4	31.1	34.3	31.6	31.9	32.95	34.85	34
	SOx	80	6.65	6.6	6.6	6.9	6.75	6.85	7.05	6.75	6.6	7.05	7.35	7.5
	NOx	80	11.1	11.45	8.75	12.1	11	12.45	12.45	10.2	10.55	12.15	12.65	12.5
	CO	4000	573	630	687	687.5	687	687.5	744.5	630	630	744.5	744.5	744.5

### Day time Noise Levels [in dB(A)] for 2023-24

Location	Apr-23	May-23	Jun-23	Jul-23	Aug-23	Sep-23	Oct-23	Nov-23	Dec-23	Jan-24	Feb-24	Mar-24
Near Main Gate	57.8	58.4	56.7	59.4	58.6	61.8	63.4	55.9	58.3	59.4	60.2	59.4
Near STP	69.2	59.2	59.2	60.3	58.1	68.4	62.4	63.6	60.4	63.1	61.9	62.6
Near Weigh Bridge	60.3	60.4	59.8	64.1	61.3	64.3	71.2	70.1	67.6	65.1	67.8	64.1
Mass Office	60.1	62.7	63.3	62.2	59.7	58.2	66.8	64.8	62.1	63.4	65.7	63.9
<b>Permissible Limit</b>	<b>75</b>											

### Night time Noise Levels [in dB(A)] for 2023-24

Location	Apr- 23	May- 23	Jun- 23	Jul-23	Aug- 23	Sep- 23	Oct- 23	Nov- 23	Dec- 23	Jan- 24	Feb- 24	Mar- 24
Near Main Gate	53.4	54.1	54.5	56.1	55.3	57.5	55.9	50.6	52	52.1	53.7	54.1
Near STP	63.5	54.9	50.0	56.1	56.6	63.7	58.3	60.7	56.3	60.2	57.5	58.8
Near Weigh Bridge	53.9	53.2	52.5	56.2	58.2	56.6	62.5	65.4	63.9	58.2	60.5	62
Mass Office	55.7	58.3	56.7	57.4	54.8	53.7	59.1	60.2	57.5	54.5	56.3	55.7
<b>Permissible Limit</b>	<b>70</b>											

### Final Treated Water Analysis Report for 2023-24

Parameters	Limits	Apr- 23	May- 23	Jun- 23	Jul- 23	Aug- 23	Sep- 23	Oct- 23	Nov- 23	Dec- 23	Jan- 24	Feb- 24	Mar- 24
TSS mg/lit	<b>100</b>	<5	<5	<5	<5	<5	<5	<5	<5	<5	<5	<5	<5
BOD mg/lit	<b>30</b>	<2	<2	<2	<2	<2	<2	<2	<2	<2	<2	<2	<2
COD mg/lit	<b>250</b>	<5	<5	<5	<5	<5	<5	<5	<5	<5	<5	<5	<5
pH	<b>6.0-8.5</b>	7.55	7.19	7.40	7.09	7.56	7.82	7.63	7.25	7.40	7.45	7.81	7.45
Phosphate as P mg/lit	<b>5</b>	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
Oil & Grease mg/lit	<b>10</b>	<5	<5	<5	<5	<5	<5	<5	<5	<5	<5	<5	<5
Free Available Chlorine mg/lit	<b>0.5</b>	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2
Copper mg/lit	<b>1</b>	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01
Iron mg/lit	<b>1</b>	0.06	0.05	0.03	0.05	0.04	0.06	0.04	0.06	0.04	0.03	0.05	0.07
Total Chromium Cr+6 mg/lit	<b>0.2</b>	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01
Zinc mg/lit	<b>1</b>	0.05	0.08	0.04	0.08	0.11	0.15	0.10	0.07	0.10	0.08	0.10	0.12
Sulphide mg/lit	<b>2</b>	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
Temperature °C	<b>Not more than 10°C higher than the intake water temperature</b>	29.4	38.7	30.1	29.5	31.3	29.8	31.5	27.3	22.9	20.4	24.5	28.9

## Ashok Nagar STP Analysis Report for 2023-24

Except pH all value are in mg/lit

Parameters	Limits	Apr-23	May-23	Jun-23	Jul-23	Aug-23	Sep-23	Oct-23	Nov-23	Dec-23	Jan- 24	Feb- 24	Mar- 24
Total Suspended Solids	100	27	39	13	17	15	14	16	23	18	20	14	10
pH Value	5.5-9.0	7.22	7.31	7.24	7.29	7.07	7.14	7.18	7.34	7.28	7.29	7.05	7.43
Oil and Grease	10	3	4	3	3	3	2	<5	<5	<5	<5	<5	<5
Total Residual Chlorine	1	<0.1	<0.1	<0.1	<0.1	0.3	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
Ammonical Nitrogen (as N)	50	6.28	8.19	7.28	3.44	8.15	1.48	11	16.4	12	14.7	6.3	5.3
Total Kjeldahl Nitrogen (as N)	100	19.82	29.91	15.77	15.17	28.78	6.63	16.2	23.5	17.6	20.4	8.5	8.6
Biochemical Oxygen Demand (3 days at 27°C)	30	9.75	17.33	9.17	9.8	13.5	5.71	18	20	18	19	13	11
Sulphide (as S)	2	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.5	<0.5	<0.5	<0.5	<.5	<.5
Nitrate Nitrogen	10	3.02	5.89	8.09	7.52	7.95	5.71	3.60	4.20	3.4	4.9	4.2	3.1
Chlorides	1000	116.56	82.56	172.29	123.51	90.26	95.01	121.96	139.96	145.9	131.9	117.9	139.9
Sulphates	1000	28.87	24.28	20.86	25.25	29.82	28.75	518.25	614.27	510.5	485.2	395.6	368.3
Chemical Oxygen Demand	250	65.5	112.13	51.58	66.24	78.4	34.5	138	152	140	153	119	85

### Total Expenses for 2023-24

Particulars	Amount in Rs.
Plantation/Monitoring/Ash/RSPCB/Other Env Exp	<b>3,89,307.25</b>

